$^{1}/_{16}$ - $^{1}/_{8}$ - $^{1}/_{4}$ DIN LIMIT CONTROLLERS **CONCISE PRODUCT MANUAL (59333-2)**




CAUTION: Installation should be only performed by technically competent personnel. Local Regulations regarding electrical installation & safety must be observed.


1. INSTALLATION

The models covered by this manual have three different DIN case sizes (refer to section 9). Some installation details vary between models. These differences have

Note: The functions described in sections 2 thru 8 are common to all models. **Installing Option Modules**

¹/₁₆ Din Size Instruments

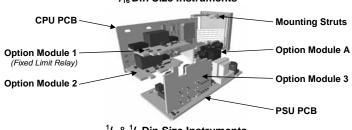

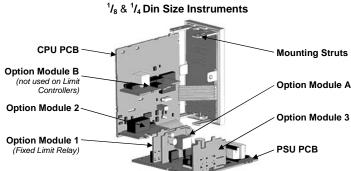


To access module A, first detach the PSU and CPU boards from the front by lifting first the upper, and then lower mounting struts. Gently separate the boards. Plug the required option modules into the correct connectors, as shown below.


- Locate the module tongues in the corresponding slot on the opposite board.
- Hold the main boards together while relocating back on the mounting struts. Replace the instrument by aligning the CPU and PSU boards with their guides in the housing, then slowly push the instrument back into position.

Note: Option modules are automatically detected at power up.

Option Module Connectors





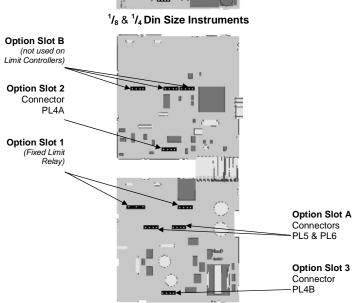


Panel-Mounting

The mounting panel must be rigid, and may be up to 6.0mm (0.25inch) thick. Cut-out sizes are

Cut-Out Dim A /₁₆ & ¹/₈ Din = 45mm $/_{4}$ Din = 92mm



For *n* multiple instruments mounted side-by-side, cut-out A is 48n-4mm ($^{1}/_{16}$ & $^{1}/_{8}$ Din) or 96n-4mm ($^{1}/_{4}$ Din)



to bezel only)

Slide mounting clamp over the instrument Mounting Panel housing towards rear face of mounting panel until the tongues engage in Instrument ratchets and instrument is Housing clamped in position. Hold instrument firmly in Gasket position (apply pressure




CAUTION: Do not remove the panel gasket; it is a seal against dust and


Rear Terminal Wiring

USE COPPER CONDUCTORS (EXCEPT FOR T/C INPUT)

Single Strand wire gauge: Max 1.2mm (18SWG)

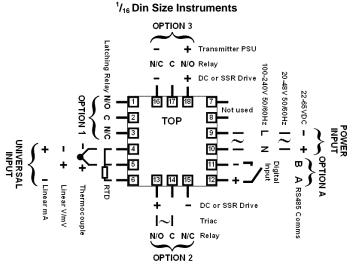

1/8 & 1/4 Din Size Instruments

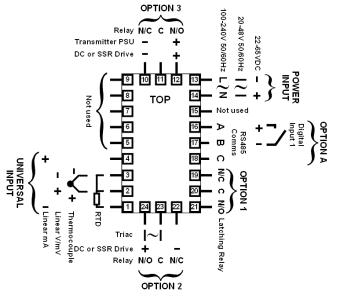

These diagrams show all possible option combinations. The actual connections required depends on the exact model and options fitted.



CAUTION: Check information label on housing for correct operating voltage before connecting supply to Power Input Fuse: 100 - 240V ac - 1amp anti-surge 24/48V ac/dc - 315mA anti-surge

Note: At first power-up the message Goto ConF is displayed, as described in section 6 of this manual. Access to other menus is denied until configuration mode is completed

2. SELECT MODE

Select mode is used to access the configuration and operation menu functions. It can be accessed at any time by holding down and pressing. In select mode, press or voto choose the required mode, press to enter. An unlock code is required to prevent unguitherized enter to Configuration 6.0. An unlock code is required to prevent unauthorised entry to Configuration, & Setup modes. Press or to enter the unlock code, then press to proceed.

Mode	Upper	Lower	Description	Default	
	Display	Display		Unlock	
				Codes	
Operator	OPŁr	SLCE	Normal operation	None	
Set Up	SEŁP	SLCE	Tailor settings to the application	10	
Configuration	Conf	SLCE	Configure the instrument for use	20	
Product Info	ınfo	SLCE	Check manufacturing information	None	

Note: The instrument will always return automatically to Operator mode if there is no key activity for 2 minutes.

3. CONFIGURATION MODE

Display Display

inPt

Input

Range/Type

First select Configuration mode from Select mode (refer to section 2). Press to scroll through the parameters, then press of or to set the required value. Press to accept the change, otherwise parameter will revert to previous value. To exit from Configuration mode, hold down and press , to return to

Note: Parameters displayed depends on how instrument has been configured. Refer to user guide (available from your supplier) for further details. Parameters marked * are repeated in Setup Mode.

Lower Upper Adjustment range & Description

See following table for possible codes

Default

Value

Kange/	ige/ i ype				Code Input Ty		
Code	Input Typ Range	oe &	Code	ode Input Type & Range		Input Typ Range	e &
ьε	B: 100 - 18	24 ºC	<i>L.€</i> L: 0.0 - 537.7 °C		0.200	DtDh20% vc 40%:	
ЬF	B: 211 - 33	15 °F	LF	L: 32.0 - 999.9 °F		32 - 3362 °F	
ΕΕ	C: 0 - 2320	°C	NE	N: 0 - 1399 °C	PEE	Pt100: -19	9 - 800 °C
<i>[F</i>	C: 32 - 420	8 ºF	NF	N: 32 - 2551 °F	PŁF	Pt100: -32	8 - 1472 °F
JE	J: -200 - 1	200 °C	rΕ	R: 0 - 1759 °C	PŁ.C	Pt100: -12	8.8 - 537.7 °C
JF	J: -328 - 2	192 ºF	гF	R: 32 - 3198 °F	PŁ.F	Pt100: -19	9.9 - 999.9 °F
J.E	J: -128.8 ·	- 537.7 °C	50	S: 0 - 1762 °C	0-50	0 - 20 mA [OC
J.F	J: -199.9 -	999.9 °F	5F	S: 32 - 3204 °F	4_20	4 - 20 mA [OC .
PΕ	K: –240 - 1	373 °C	Ŀε	T: -240 - 400 °C	0.50	0 - 50 mV [OC .
ΥF	K: -400 - 2	2503 °F	ĿF	T: -400 - 752 °F	10.50	10 - 50 mV	DC
P.E	K: –128.8 -	537.7 °C	Ł.£	T: -128.8 - 400.0 °C	0.5	0 - 5 V DC	
P.F	K: –199.9 -	999.9 °F	Ł.F	T: -199.9 - 752.0 °F	1_5	1 - 5 V DC	
LE	L: 0 - 762 °	С	P24C	PtRh20% vs. 40%:	0_10	0 - 10 V DO	
LF	L: 32 - 140	3 ºF	FEAL	0 - 1850 °C	2_10	2 - 10 V DO	
Note: L	Decimal p	oint sho	wn in ta	ble indicates temp	perature	resolutio	n of 0.1°
Param	eter	Lower Display	Upper Display	Adjustment rang	ge & De	scription	Default Value
Scale F		ruL	5	Scale Range Lower		00	Range max
Upper I Scale F				to Range Max Range Minimu			(Lin=1000) Range min
Lower I		rLL	Ç	Scale Range Upper Limit -100			(Linear=0)
Decima		dPoS		0 =xxxx, 1 =xxx.x, 2 =xx.xx, 3 =x.xxx			
position	n s Variable		((non-temperature ranges only)			·
Offset	s variable	OFFS	±Span of controller (see CAUTION note at end of section)			0	
				High Limit.			
Limit A	ction	_	Н.	Limit relay is e process "safe" (P\			
	Clion	CtrL		Low Limit.		Cotponity	H i
			Lo	Limit relay is e			
Setnoir	nt Upper			process "safe" (P\			
Setpoil Limit	ır Obbei	SPuL	Curren	t Setpoint to Scale	Range r	naximum	R/max
Setpoir Limit	nt Lower	SPLL	Scale	Range minimum to	Current	Setpoint	R/min
			P_H i	P_H Process High Alarm			
	_		P_Lo				
Alarm 1	Туре	ALA I	Deviation Alarm			P_H	
				bAnd Band Alarm			
High Al	arm 1		nonE No alarm				
value*		PhA I	Scaled Range Minim				Range Max
Low Ala value*	arm 1	PLA I	scaled Range Maximum in display units		Range Min		
Band A value*	larm 1	bal i	1 LSD to span from setpoint in display units			play units	5
Dev. Al value*	arm 1	dAL I	+/- Span from setpoint in display unit			y units	5
Alarm 1 Hystere		AHY I	1 LSD to full span in display			units	_!
. 1,01010	, , , ,						

Parameter	Lower Display	Upper Display	Adjustment range & Description	Default Value	
Alarm 2 Type*	ALA2			P_Lo	
High Alarm 2 value*	PhA2			Range Max	
Low Alarm 2 value*	PLA2		Range Min		
Band Alarm 2 value*	PATS		Options as for alarm 1		
Dev. Alarm 2 Value*	4AL2			5	
Alarm 2 Hysteresis*	BH75			1	
		レット	Limit Output Relay		
		A I_d	Alarm 1, Direct		
		A I_r	Alarm 1, Reverse		
		AS_d	Alarm 2, Direct		
		A2_r	Alarm 2, Reverse		
		Or_d	Logical Alarm 1 OR 2, Direct	R 1_d	
Output 2 Usage	USE2	0r_r	Logical Alarm 1 OR 2, Reverse		
		Ad_d	Logical Alarm 1 AND 2, Direct		
		Ad_r	Logical Alarm 1 AND 2, Reverse		
		An_d	Limit Annunciator, Direct		
		An_r	Limit Annunciator, Reverse		
		rEF2	Retransmit Limit SP Output	-£էР	
		rEtP	Retransmit PV Output		
		0_5	0 to 5 V DC output 1		
Linear Output 2		0_ 10	0 to 10 V DC output		
Range	FA65	5_ 10	2 to 10 V DC output	0_ 10	
		0-50	0 to 20 mA DC output		
5		4_20	4 to 20 mA DC output		
Retransmit Output 2 Scale	ro2H	-1999 to 9999 (display value at which output		Range max	
maximum	roen	(display value at which output will be maximum)		Range max	
Retransmit		-1999 to 9999			
Output 3 Scale	ro2L	(display value at which output	Range min	
minimum	ucca		will be minimum)	0.1	
Output 3 Usage	USE3	As for output 2		R I_d	
Linear Output 3 Range	FAb3		As for output 2	0_ 10	
Retransmit Output 3 Scale	ro3H	(-1999 to 9999 display value at which output	Range max	
maximum	ייכטיי	(will be maximum)	Trange max	
Retransmit			-1999 to 9999		
Output 3 Scale	ro3L	(display value at which output	Range min	
minimum		EnAb	will be minimum) PV is visible in Operator mode		
		d iSA	PV not visible in Operator mode		
Display Strategy	d iSP		Displays SAFE in Operator mode	EnAb	
		SAFE	when Limit Output is not active		
		ASC I	ASCII		
Serial		₽ P	Modbus with no parity	00:	
Communications Protocol	Prot	rape	Modbus with Even Parity	ՐՊԵՐ	
Piolocoi		ГЛРО	Modbus with Odd Parity		
		1.2	1.2 kbps		
Serial		2.4	2.4 kbps		
Communications	bRud	4.8	4.8 kbps	4.8	
Bit Rate	0100	9.6 kbps			
		9.6 kbps 19.2 kbps			
Comms Address	Addr		•		
Commis Address	-noor		o 255 (Modbus), 1 to 99 (ASCII)		
Comms Write	CoEn	Read/Write Read only		لاملاء	
Configuration Lock Code	CLoc		0 to 9999	20	

Notes: Output 1 is always a Latching Limit Relay output. If Option Slot A has the Digital Input module fitted, this always functions as a Remote Reset, duplicating the function of the Reset) key

As these functions cannot be changed, no Configuration menus are required.



CAUTION: Process Variable Offset can be used to modify the measured value to compensate for probe errors. Positive values increase the reading, negative values are subtracted. This parameter is effectively, a calibration adjustment and MUST be used with care. There is no front panel indication of when this parameter is in use.

SETUP MODE

Note: Configuration must be completed before adjusting Setup parameters First select Setup mode from Select mode (refer to section 2). The Setup LED will light while in Setup mode. Press to scroll through the parameters,

then press or to set the required value.

To exit from Setup mode, hold down and press to return to Select mode. Note: Parameters displayed depends on how instrument has been configured.

Parameter	Lower Display	Upper Display Adjustment Range & Description	Default Value
Limit Setpoint value	5P	Scaled Range Minimum to scaled Range Maximum	R/max if CtrL=H , R/min if CtrL=Lo
Limit Hysteresis	HYSE	1 LSD to full span in display units, on the safe side of the limit SP	1
Input Filter Time Constant	F iLE	OFF or 0.5 to 100.0 secs (see CAUTION note below)	2.0
High Alarm 1 value	PhA I	Scaled Range Minimum to	R/max
Low Alarm 1 value	PLR I	scaled Range Maximum	R/min
Deviation Alarm 1 Value	dAL I	±Span from SP in display units	5
Band Alarm 1 value	bal i	1 LSD to span from setpoint	5
Alarm 1 Hysteresis	AHY I	1 LSD to full span in display units	1
High Alarm 2 value	6445	Scaled Range Minimum to	R/max
Low Alarm 2 value	PLA2	scaled Range Maximum	R/min
Deviation Alarm 2 Value		±Span from SP in display units	5
Band Alarm 2 value 6AL2		1 LSD to span from setpoint	5
Alarm 2 Hysteresis	8H45	1 LSD to full span in display units	-
Setup Lock Code	SLoc	0 to 9999	10

Note: Operator mode screens follow, without exiting from Setup mode.

CAUTION: An excessively large filter time could significantly delay detection of a limit condition. Set this value to the minimum required to remove noise from the process variable

5. PRODUCT INFORMATION MODE

First select Product information mode from Select mode (refer to section 2). Press to view each parameter. To exit from Product Information mode, hold down and press to return to Select mode.

Parameter	Lower Display	Upper Display	Description	
Input type	In_ I	Un i	Universal input	
Option 1 type (fixed)	OPn I	LLY	Latching Limit Relay	
		nonE	No option fitted	
0 " 0 11 1		LL	Relay output	
Option 2 module type fitted	0Pn2	55r	SSR drive output	
intod		۴rı	Triac output	
		Lin	Linear DC voltage / current output	
		nonE	No option fitted	
0 11 1		LL	Relay output	
Option 3 module type fitted	0Pn3	SSr	SSR drive output	
intod		Lin	Linear DC voltage / current output	
		dc24	Transmitter power supply	
A	0PnR	nonE	No option fitted	
Auxiliary Option A module type fitted		-485	RS485 communications	
modulo typo nitod		٩. ٢٠	Digital Input for remote reset	
Firmware type	FLJ	Value displayed is firmware type number		
Firmware issue	155	Value displayed is firmware issue number		
Product Revision Level	PrL	Value displayed is Product Revision level		
Date of manufacture	4000	Manufacturing date code (mmyy)		
Serial number 1	5n 1	First four digits of serial number		
Serial number 2	502	Middle four digits of serial number		
Serial number 3	5n3	Last four digits of serial number		

6.	ERRC	R/FAUI	LT INDI	CATIONS

Parameter	Upper	Lower	Description
	Display	Display	
			Configuration & Setup required. This screen is
Instrument			seen at first turn on, or if hardware configuration has been changed. Press to
parameters are in	Goto	Conf	enter the Configuration Mode, next press
default conditions			△ or ▽ to enter the unlock code number.
			then press 5 to proceed
Innut Over Benge	CHH)	Normal	Process variable input > 5% over-range
Input Over Range	Normal	CHH)	as above if Display Strategy = SAFE
Input Under	CLL	Normal	Process variable input > 5% under-range
Range	Normal	CLLO	as above if Display Strategy = SAFE
Innut Concer	OPEN	Normal	Break detected in process variable input
Input Sensor Break			sensor or wiring
Dieak	Normal	OPEN	as above if Display Strategy = SAFE
Option 1 Error		OPn I	Option 1 module fault
Option 2 Error	Err	0Pn2	Option 2 module fault
Option 3 Error		0Pn3	Option 3 module fault
Option A Error		OPnA	Option A module fault
Option B Error		OPnb	Option B not used on Limit Controllers
- P.I.O D EIIOI		טוייט	this error is shown if any module is fitted

7. OPERATOR MODE

This mode is entered at power on, or accessed from Select mode (see section 2) Note: All Configuration mode and Setup mode parameters must be set as required before starting normal operations. Press to scroll through the parameters.

Upper Display	Lower Display	Display Strategy and When Visible	Description
PV Value	Limit SP Value	d ,SP = EnAb (initial screen)	PV and Limit Setpoint values Read only
Limit SP Value	(Blank)	d iSP = d iSA (initial screen)	Limit Setpoint value Read only
SAFE or rSEL	(Blank) or PV Value	d iSP = SAFE. (Initial Screen)	Displays rSEL and PV if Limit Output is active or SRFE and <i>blank</i> if not active. <i>Read only</i>
High Limit Hold	н на	CtrL = H ,	Highest PV value since this parameter was last reset. To reset, press of for 5 seconds, display = when reset
Low Limit Hold	LoHd	[trl = Lo	Lowest PV value since this parameter was last reset. To reset, press for 5 seconds, display = when reset
Exceed Time Value	Ł١	Always available Format mm.ss to 99.59 then mmm.s (10 sec increments) Shows [HH] if ≥999.9	Accumulated time of Limit SP exceed conditions since this parameter was last reset. To reset, press for 5 seconds, display = when reset
Active Alarm Status	ALSE	When one or more alarms are active. ALM indicator will also flash	Alarm 2 active Alarm 1 active Annunciator active

Exceed Condition

An Exceed Condition is when the Process Variable exceeds the Limit Setpoint value (i.e. PV > SP when set for high limit action, PV < SP for low limit action). The LED is on during this condition, and is extinguished once it has passed. **Limit Output Function**

Limit Output relay(s) de-energise whenever an Exceed condition occurs, causing the process to shut down. The LED is on when the relay is de-energised. The relay remains latched off even if the Exceed condition is no longer present. Only giving a reset instruction (after the exceed condition has passed) will reenergise the relay, allowing the process to continue. The LED then turns off. **Limit Annunciator Outputs**

An Annunciator output will activate when an Exceed condition occurs, and will remain active until a reset instruction is received, or the Exceed condition has passed. Unlike the Limit Output, an Annunciator can be reset even if the Exceed condition is present. When an Annunciator is active, the LED will flash and the Alarm Status screen is available.

Resetting Limit Outputs & Annunciators

A reset instruction can be given by pressing the key, via the Digital Input (if fitted) or via a Comms command if an RS485 Communications module is fitted. Annunciators will deactivate. Limit Outputs will only re-energise if the Exceed condition has passed.



CAUTION: Ensure that the cause of the Exceed condition has been rectified before resetting the Limit Output.

8. SERIAL COMMUNICATIONS

Refer to the full user guide (available from your supplier) for details.

9. SPECIFICATIONS

UNIVERSAL INPUT

Thermocouple ±0.1% of full range, ±1LSD (±1°C for Thermocouple CJC).

BS4937, NBS125 & IEC584. Calibration: PT100 Calibration:

 $\pm 0.1\%$ of full range, ± 1 LSD.

BS1904 & DIN43760 (0.00385Ω/Ω/°C).

DC Calibration: ±0.1% of full range, ±1LSD.

Sampling Rate: 4 per second.

Impedance: >10M Ω resistive, except DC mA (5 Ω) and V (47k Ω).

Sensor Break Thermocouple, RTD, 4 to 20 mA, 2 to 10V and 1 to 5V ranges Detection:

only. Limit outputs turn off (goes into Exceed condition), high alarms activate for thermocouple/RTD sensor break. low

alarms activate for mA/V DC sensor break.

Isolation: Isolated from all outputs (except SSR driver).

> Universal input must not be connected to operator accessible circuits if relay outputs are connected to a hazardous voltage source. Supplementary insulation or input grounding would

then be required.

DIGITAL INPUT

Volt-free(or TTL): Open(2 to 24VDC) =No Reset.

Closed(<0.8VDC) = Reset (edge triggered).

Isolation: Reinforced safety isolation from inputs and other outputs.

OUTPUTS

Limit Relay

Latching limit control relay. Single pole double throw (SPDT); Contact Type & 5A resistive at 120/240VAC. Slot 1 position fixed for this

function, optional function for Slot 2 & 3 relay modules,

>100,000 operations at rated voltage/current. Lifetime

Isolation: Basic Isolation from universal input and SSR outputs.

Alarm Relays

Contact Type & Slot 2 or 3 position non-latching alarm relay.

Single pole double throw (SPDT); 2A resistive at 120/240VAC. Rating:

Lifetime: >500,000 operations at rated voltage/current.

Isolation: Basic Isolation from universal input and SSR outputs.

SSR Driver

Drive Capability: SSR drive voltage >10V into 500Ω min.

Not isolated from universal input or other SSR driver outputs. Isolation:

Operating Voltage: 20 to 280Vrms (47 to 63Hz).

0.01 to 1A (full cycle rms on-state @ 25°C): Current Rating: derates linearly above 40°C to 0.5A @ 80°C.

Reinforced safety isolation from inputs and other outputs.

DC

Resolution 8 bits in 250mS (10 bits in 1s typical, >10 bits in >1s typical).

Isolation: Reinforced safety isolation from inputs and other outputs.

Transmitter PSU

Power Rating: 20 to 28V DC (24V nominal) into 910 Ω minimum resistance. Isolation Reinforced safety isolation from inputs and other outputs.

SERIAL COMMUNICATIONS

Physical: RS485, at 1200, 2400, 4800, 9600 or 19200 bps. Selectable between Modbus and West ASCII. Protocols: Reinforced safety isolation from all inputs and outputs. Isolation:

OPERATING CONDITIONS (FOR INDOOR USE)

0°C to 55°C (Operating), -20°C to 80°C (Storage). Ambient

Temperature:

Relative Humidity: 20% to 95% non-condensing. Supply Voltage and 100 to 240VAC ±10%, 50/60Hz, 7.5VA

(for mains powered versions), or

20 to 48VAC 50/60Hz 7.5VA or 22 to 65VDC 5W

(for low voltage versions)

ENVIRONMENTAL

Standards: CE, UL, ULC & FM 3545, 1998

EMI: Complies with EN61326 (Susceptibility & Emissions).

Complies with EN61010-1 & UL3121. Safety Considerations: Pollution Degree 2, Installation Category II.

Front Panel Sealing: To IP66 (IP20 behind the panel).

PHYSICAL

 $^{1}/_{16}$ Din = 48 x 48mm, $^{1}/_{8}$ Din = 96 x 48mm, Front Bezel Size:

 $/_{4}$ Din = 96 x 96mm.

Depth Behind Panel: $\frac{1}{16}$ Din = 110mm, $\frac{1}{8}$ & $\frac{1}{4}$ Din = 100mm

0.21kg maximum. Weight: